



SIDE VIEW

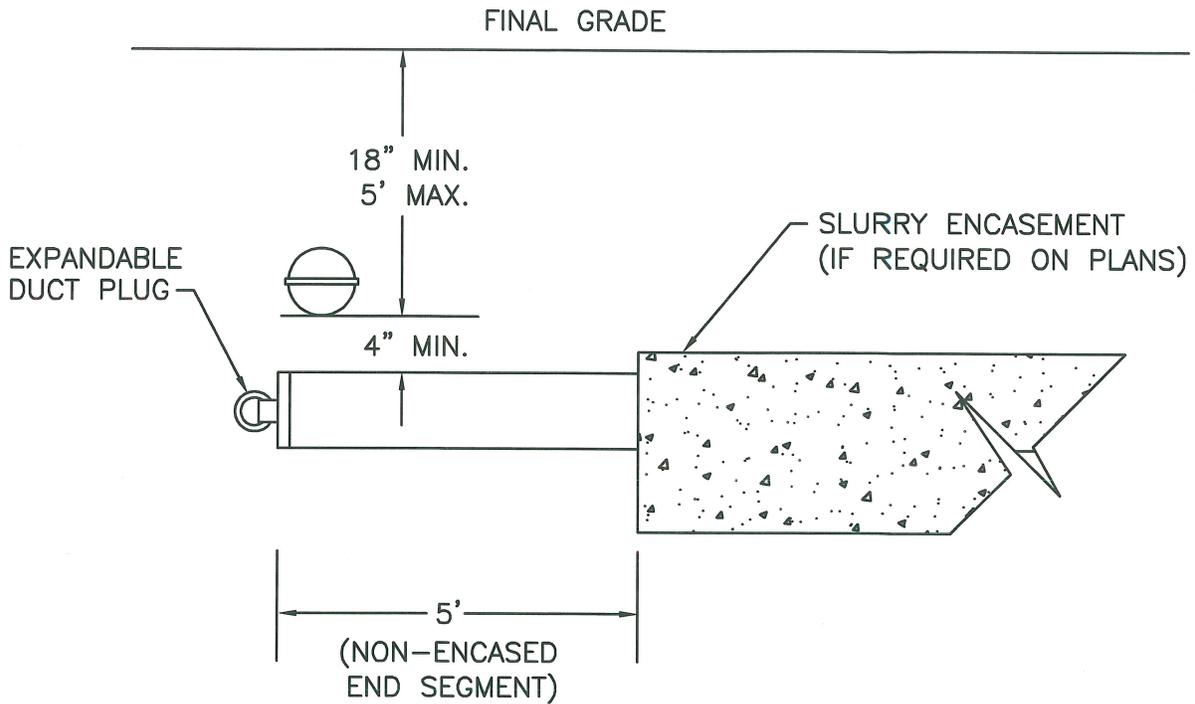

END VIEW

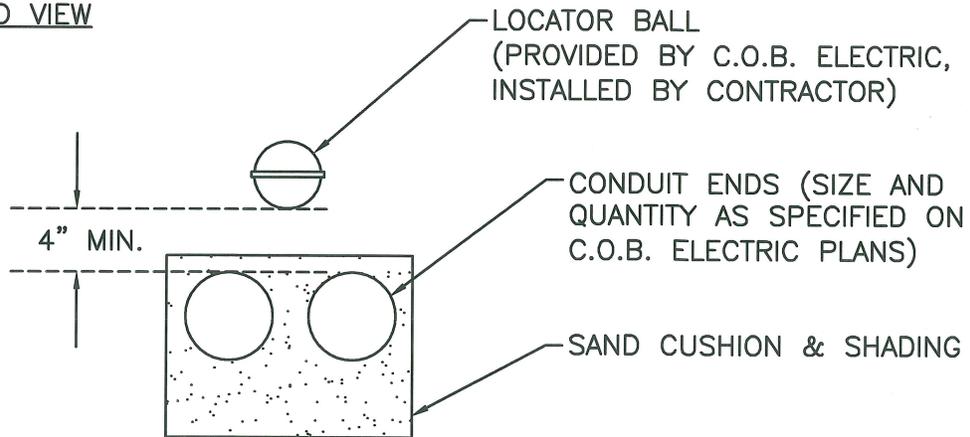

NOTES:

1. CONTRACTOR TO CONTACT C.O.B. ELECTRIC INSPECTOR FOR TRENCH AND CONDUIT INSPECTION.
2. C.O.B. ELECTRIC UTILITY TO PROVIDE LOCATOR BALL.
3. INSTALL LOCATOR BALL ABOVE CONDUIT STUB, NOT TO EXCEED 1' INWARD DISTANCE FROM END OF CONDUIT. LOCATOR BALL MUST NOT EXCEED 5' DEPTH FROM FINAL GRADE.



Proud History
Prosperous Tomorrow

REVISED: 04/12/2011

APPROVED: *RE: 10-31-11*

STANDARD DRAWINGS

LOCATOR BALL FOR
UNDERGROUND CONDUIT

SD

600-02