


MANDREL SIDE VIEW

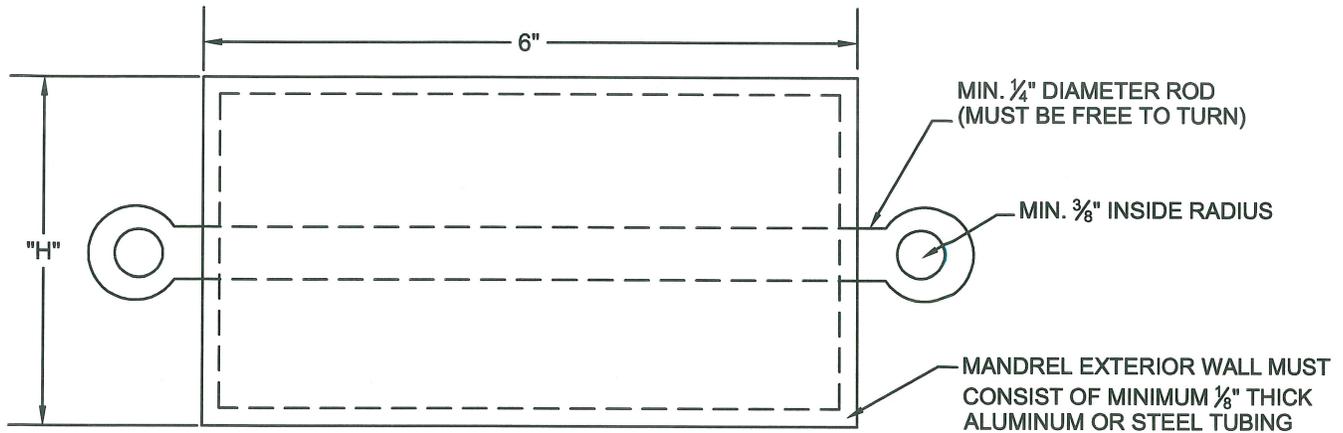


MANDREL DIAMETER TABLE

CONDUIT SIZE	"H" - SCH40	"H" - SCH80
3"	2-3/4"	2.375"
4"	3-3/4"	3.4"
5"	4-3/4"	4.4"
6"	5-3/4"	5.263"

NOTES:

1. CONTRACTOR MUST PRE-MANDREL ALL CONDUITS AT LEAST ONCE BEFORE REQUESTING A MANDREL INSPECTION FROM THE CITY OF BANNING ELECTRIC UTILITY INSPECTOR. THE INSPECTOR WILL ONLY REQUEST TO VIEW MANDRELING FOR CONDUITS 3" AND LARGER.
2. MANDREL SIZES MUST CORRESPOND TO THE SIZE AND SCHEDULE OF CONDUITS PER THE TABLE ABOVE.
3. IF THE MANDREL WILL NOT PASS THROUGH AN OBSTRUCTION, THE CONDUIT MUST BE REPLACED OR REPAIRED AT THAT POINT BY THE CONTRACTOR.
4. THE CONDUIT INSTALLER MUST PROVIDE A 3/8" CONTINUOUS (NO KNOTS, SPLICES, ETC.) YELLOW POLYPROPYLENE PULL ROPE IN EACH CONDUIT. THE ROPE SHALL HAVE A MINIMUM AVERAGE TENSILE STRENGTH OF 2700 LBS. PULL ROPE TAILS OF 72" SHALL BE SECURED AT EACH END OF CONDUIT.
5. CONDUITS SHALL BE SEALED WITH EXPANDABLE RUBBER PLUGS PROVIDED BY THE CONTRACTOR.



REVISED: 04/19/2011

APPROVED: *[Signature]* 10-31-11

STANDARD DRAWINGS

CONDUIT MANDRELING

SD

600-04