



INTERMEDIATE EXTENSION SECTION

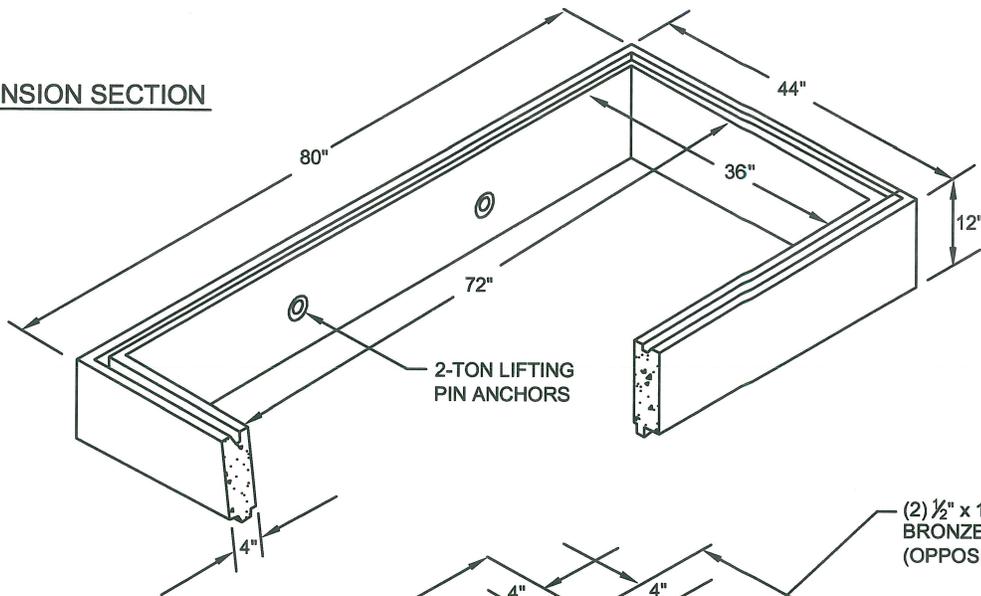

BASE ENCLOSURE

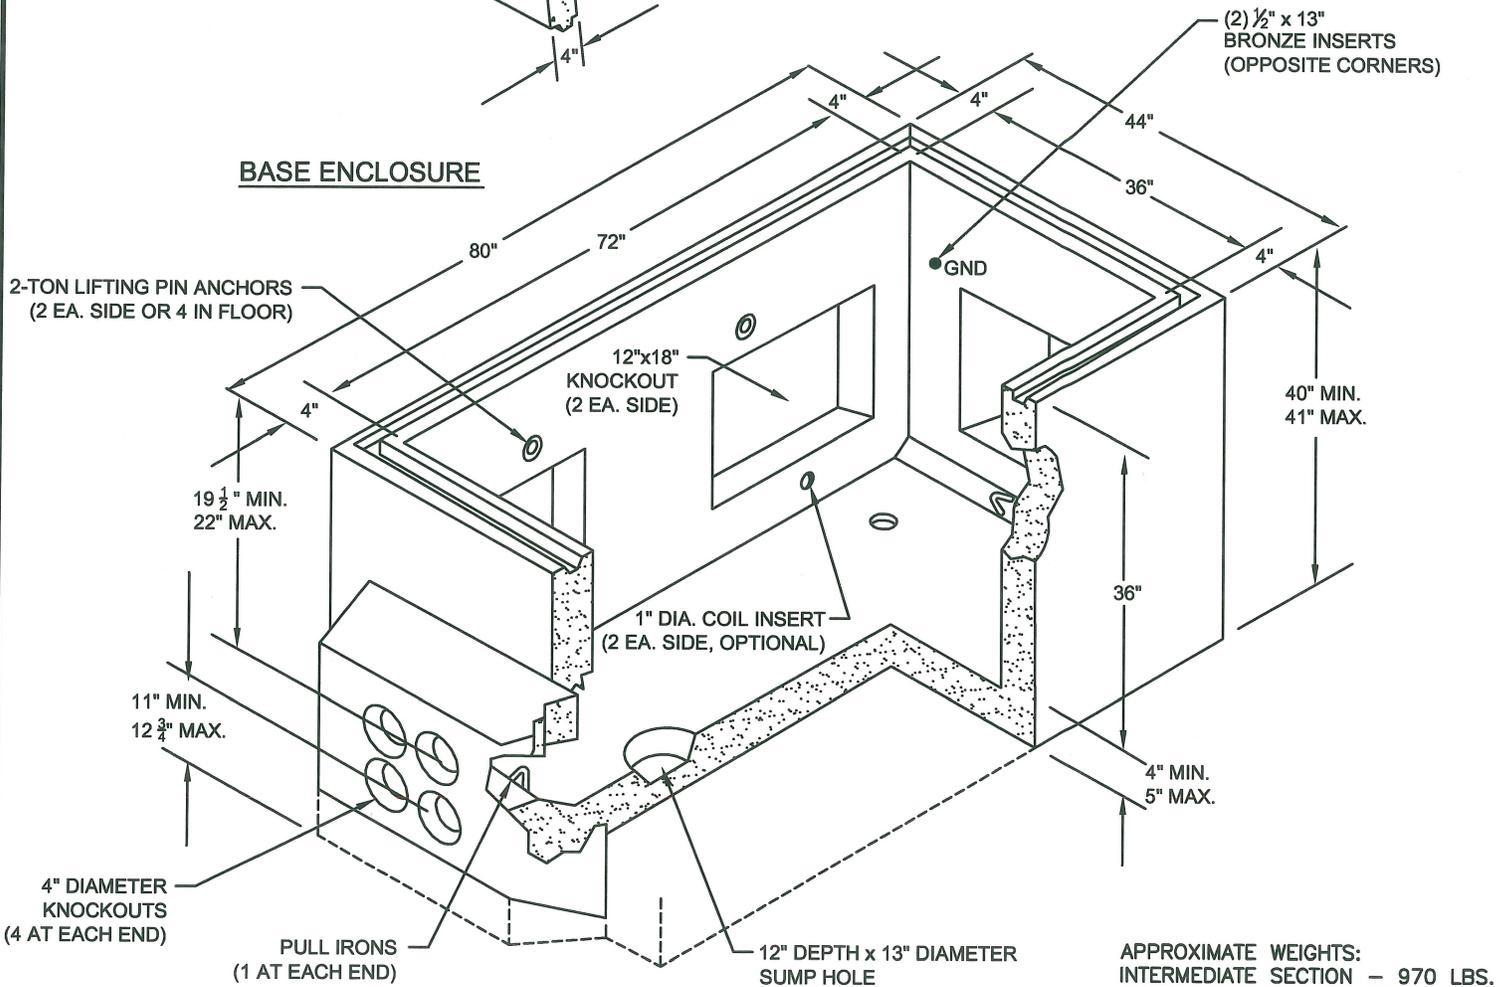

APPROXIMATE WEIGHTS:
INTERMEDIATE SECTION - 970 LBS.
BASE ENCLOSURE - 4470 LBS.

NOTES:

1. LOCATE VAULT AS DIRECTED BY C.O.B. ELECTRIC UTILITY.
2. INSTALL GROUNDING PER C.O.B. STANDARD DRAWING #600-20.
3. INSTALL A MINIMUM 8" OF 3/4" CRUSHED ROCK UNDER VAULT.
4. ALLOW UP TO 3" OF EXTRA EXCAVATION DEPTH FOR ADJUSTING LID TO FINAL GRADE.

REF: 3314.2



Proud History
Prosperous Tomorrow

REVISED: 03/17/2011

APPROVED: *R.E.B. 10-31-11*

STANDARD DRAWINGS

CONCRETE VAULT BASE, 36"x72"

SD

600-52