


THIS STANDARD SHOWS THE REQUIREMENTS FOR THE PV DIRECTORY PLAQUE THAT MUST BE PLACED ON THE SERVICE PANEL IN PLAIN VIEW.

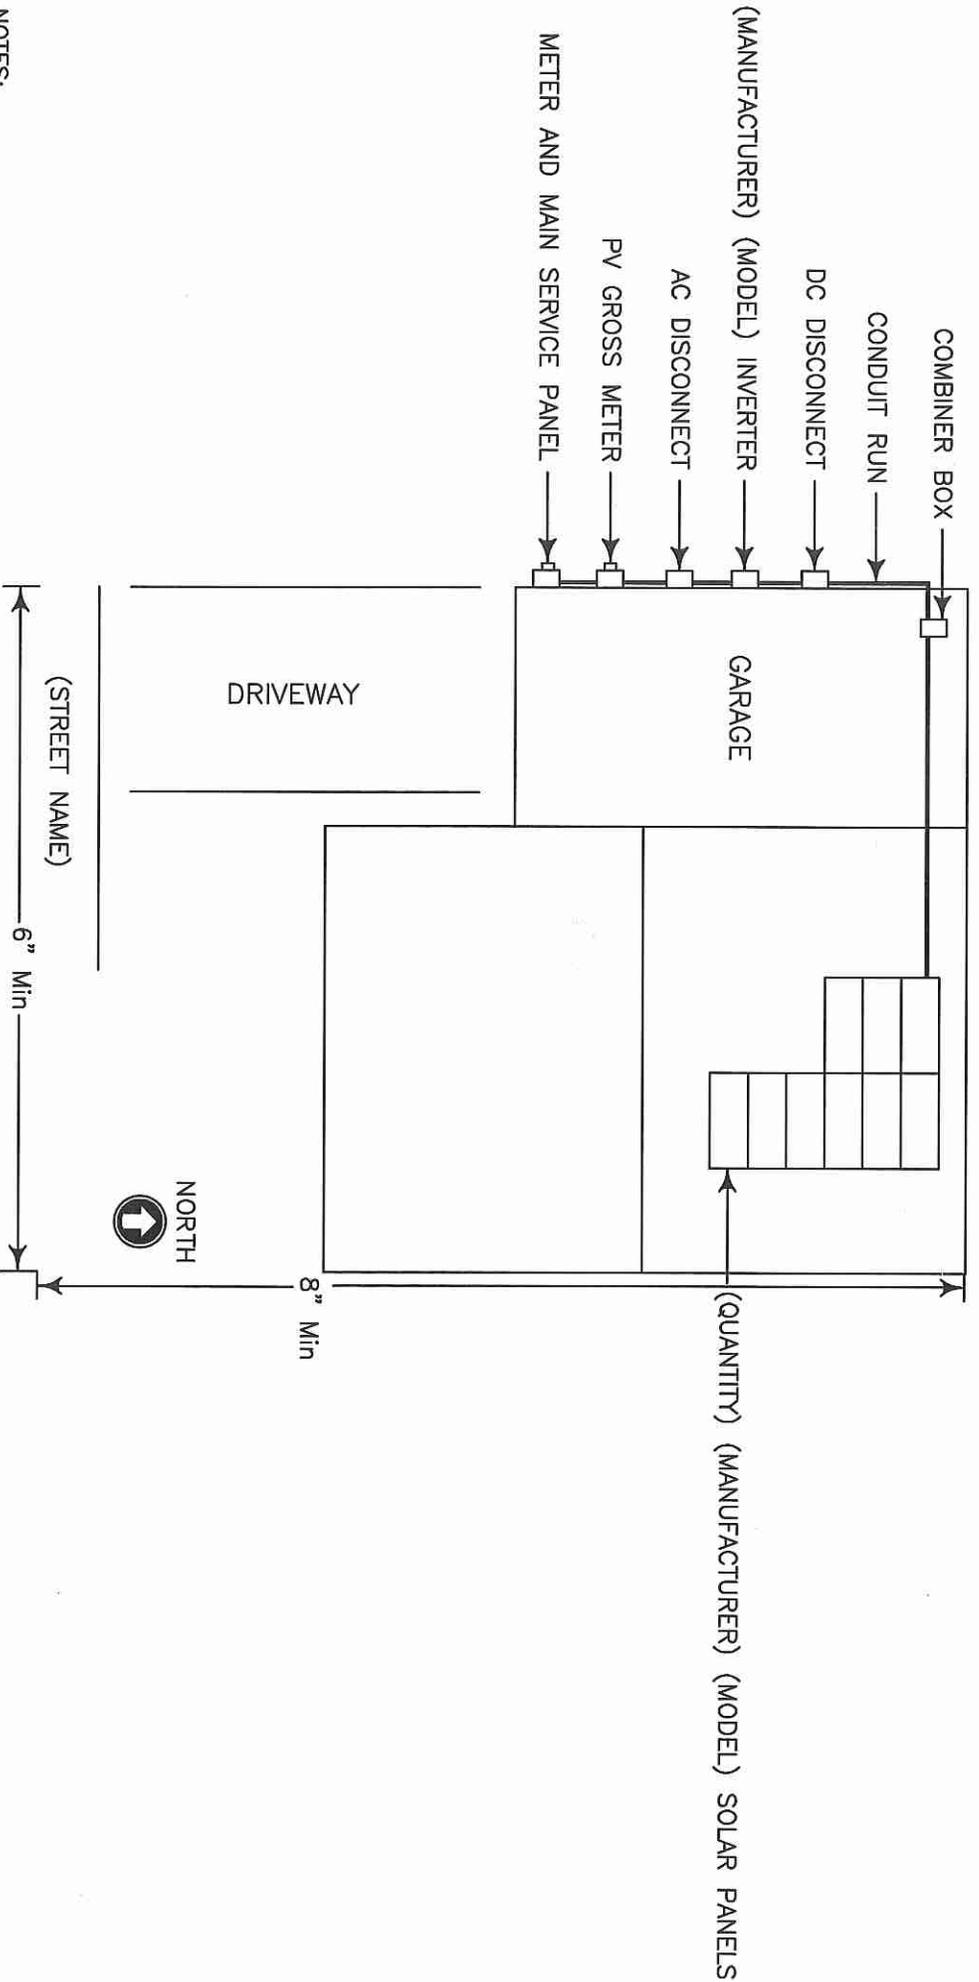

- NOTES:
1. LABELS LISTED ABOVE WITH PARENTHESES INDICATE THAT THE SPECIFIC NAME MUST BE INSERTED IN PLACE OF THOSE GENERAL TERMS.
 2. DIRECTORY PLAQUE MUST BE PLACED ON THE SERVICE PANEL IN CLEAR VIEW WITHOUT COVERING MANUFACTURER LABELING.
 3. DIRECTORY PLAQUE MUST BE UNIQUE TO EACH HOUSE IT REPRESENTS (I.E. ROOF LAYOUT, EQUIPMENT LOCATION, ETC.)
 4. DIRECTORY PLAQUE MUST BE A MINIMUM SIZE OF 6" x 8".
 5. FONT STYLE SHALL BE ARIAL AND FONT SIZE SHALL NOT BE SMALLER THAN SIZE 12 AND NO LARGER THAN SIZE 28.
 6. PLAQUES SHALL BE RED WITH WHITE LETTERING.
 7. SIGNS SHOULD BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT. ALL PLAQUES SHALL BE PERMANENTLY ATTACHED TO SURFACE OF ELECTRICAL EQUIPMENT BY MEANS OF EPOXY, SCREWS, OR RIVETS. OUTDOOR SIGNS SHALL BE EITHER METAL OR PLASTIC WITH ENGRAVED OR MACHINE PRINTED LETTERS.

REVISED: 04/20/2015

APPROVED:

STANDARD DRAWINGS



PV DIRECTORY PLAQUE

SD

600-85